

ENLARGED KITCHEN PLAN - POWER

SCALE: 1/4" = 1'-0"

ROUGH-IN NOTES:


1. REFER TO FOOD SERVICE ROUGH-IN DRAWINGS FOR ALL ELECTRICAL EQUIPMENT ROUGH-IN HEIGHTS. MAXIMUM HEIGHT FOR GENERAL PURPOSE RECEPTACLES SHALL BE 48" AFF TO TOP OF BOX.
2. THE CONTRACTOR SHALL PROVIDE ALL FINAL CONNECTIONS TO KITCHEN EQUIPMENT UNLESS NOTED OTHERWISE ON THE FOOD SERVICE ROUGH-IN DRAWINGS.
3. REFER TO FOOD SERVICE ROUGH-IN DRAWINGS FOR EXACT RECEPTACLE CONFIGURATIONS TO MATCH EQUIPMENT CORD & PLUG CONFIGURATIONS. CONTRACTOR SHALL PROVIDE CORD AND PLUG WHERE REQUIRED.
4. ALL 120V, 20A RECEPTACLES IN THE KITCHEN MUST BE GROUND FAULT PROTECTED.

EQUIPMENT SCHEDULE

ITEM NO.	EQUIPMENT CATEGORY
1	20 QT. TILTING KETTLES WITH STEAM BOILER
2	30 GALLON TILTING BRAISING PAN
3	DOUBLE DECK CONVECTION OVEN

DRAWING NOTES:

1. CUT BLOCK WALL AS REQUIRED TO FLUSH MOUNT DEVICE AND RUN WIRING CONCEALED BACK TO PANEL UNDER FLOOR VIA CRAWL SPACE AREA BELOW.
2. REFER TO KITCHEN EXHAUST HOOD WIRING DIAGRAM THIS DRAWING FOR WORK RELATED TO EXHAUST HOOD EQUIPMENT.

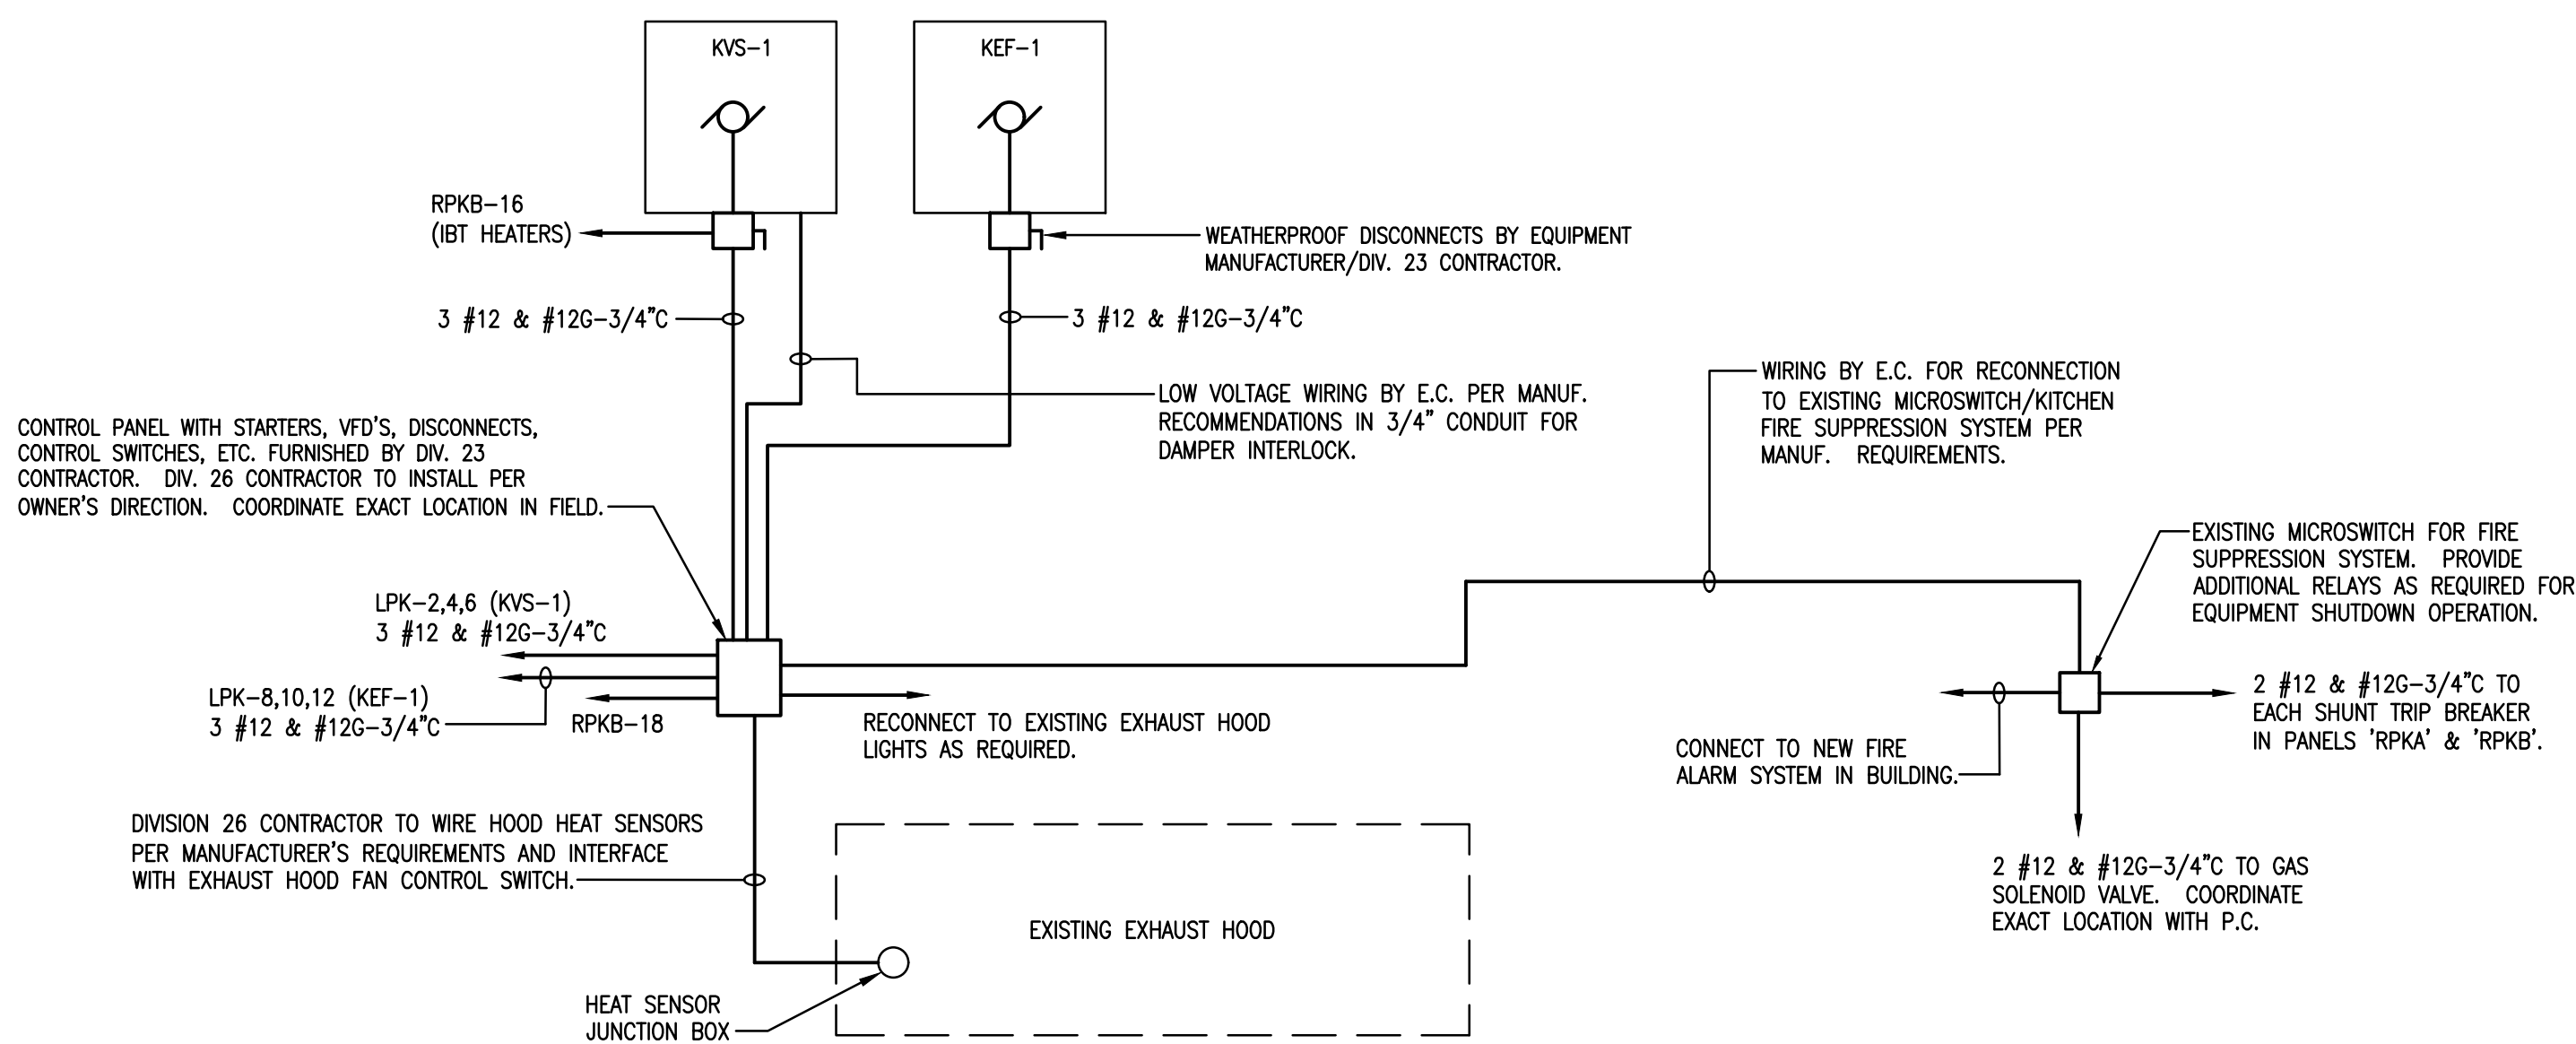


NOTES:

1. UNIT SHALL BE CONTROLLED SO THAT UPON ACTIVATION OF FIRE SUPPRESSION SYSTEM, EXHAUST FAN REMAINS ENERGIZED.
2. DIVISION 23 CONTRACTOR TO PROVIDE HEAT SENSORS WITHIN EXISTING EXHAUST HOOD.


KITCHEN EXHAUST HOOD WIRING DIAGRAM

NO SCALE



CONSOLIDATED
ENGINEERS

1022 James Drive
Leesport, PA 17033
Tel: 610-916-1600 Fax: 610-916-1610
Internet: www.consolidatedengineers.com



AEM ARCHITECTS, INC.
3700 PERKOWEN AVENUE, READING, PA 19608-2795
Phone: 610-779-3620 Fax: 610-779-3622
www.aem-arch.com

ENLARGED KITCHEN PLAN - POWER
RENOVATIONS TO THE
REAMSTOWN ELEMENTARY SCHOOL
COCALICO SCHOOL DISTRICT
SOUTH REAMSTOWN ROAD, REAMSTOWN, PENNSYLVANIA, LANCASTER COUNTY, PA

ALL DIMENSIONS AND EXISTING CONDITIONS
SHALL BE CHECKED AND VERIFIED
BY THE CONTRACTOR AT THE SITE.
JOB NO.: 22011.00
DRAWN BY: DS
DATE: 04.14.23