


GENERAL NOTES

- 1. PROVIDE DDC CONTROL PANEL FOR EQUIPMENT INDICATED.
- 2. PROVIDE VOLUME CONTROL DAMPER ON ALL SUPPLY AND RETURN BRANCH DUCTWORK.
- 3. COORDINATE ALL DDC DATA CONNECTION LOCATIONS WITH TELECOM/DATA DRAWINGS.


KEYNOTES

- 1 DDC CONTROL PANEL TO SERVE AHU'S
- 2 DDC CONTROL PANEL TO SERVE HOT WATER SYSTEM
- 3 PROVIDE FIRE DAMPER W/ ASSOCIATED DUCT ACCESS DOOR AT SLAB PENETRATION. (TYPICAL FOR ALL FIRE DAMPERS IN THIS AREA)
- 4 PROVIDE BUILDING DDC CONTROL PANEL.
- 5 PROVIDE REMOTE DAMPER CONTROL ACCESS AS INDICATED. SEE M-504 FOR MORE INFORMATION.
- 6 PROVIDE VOLUME CONTROL DAMPER.

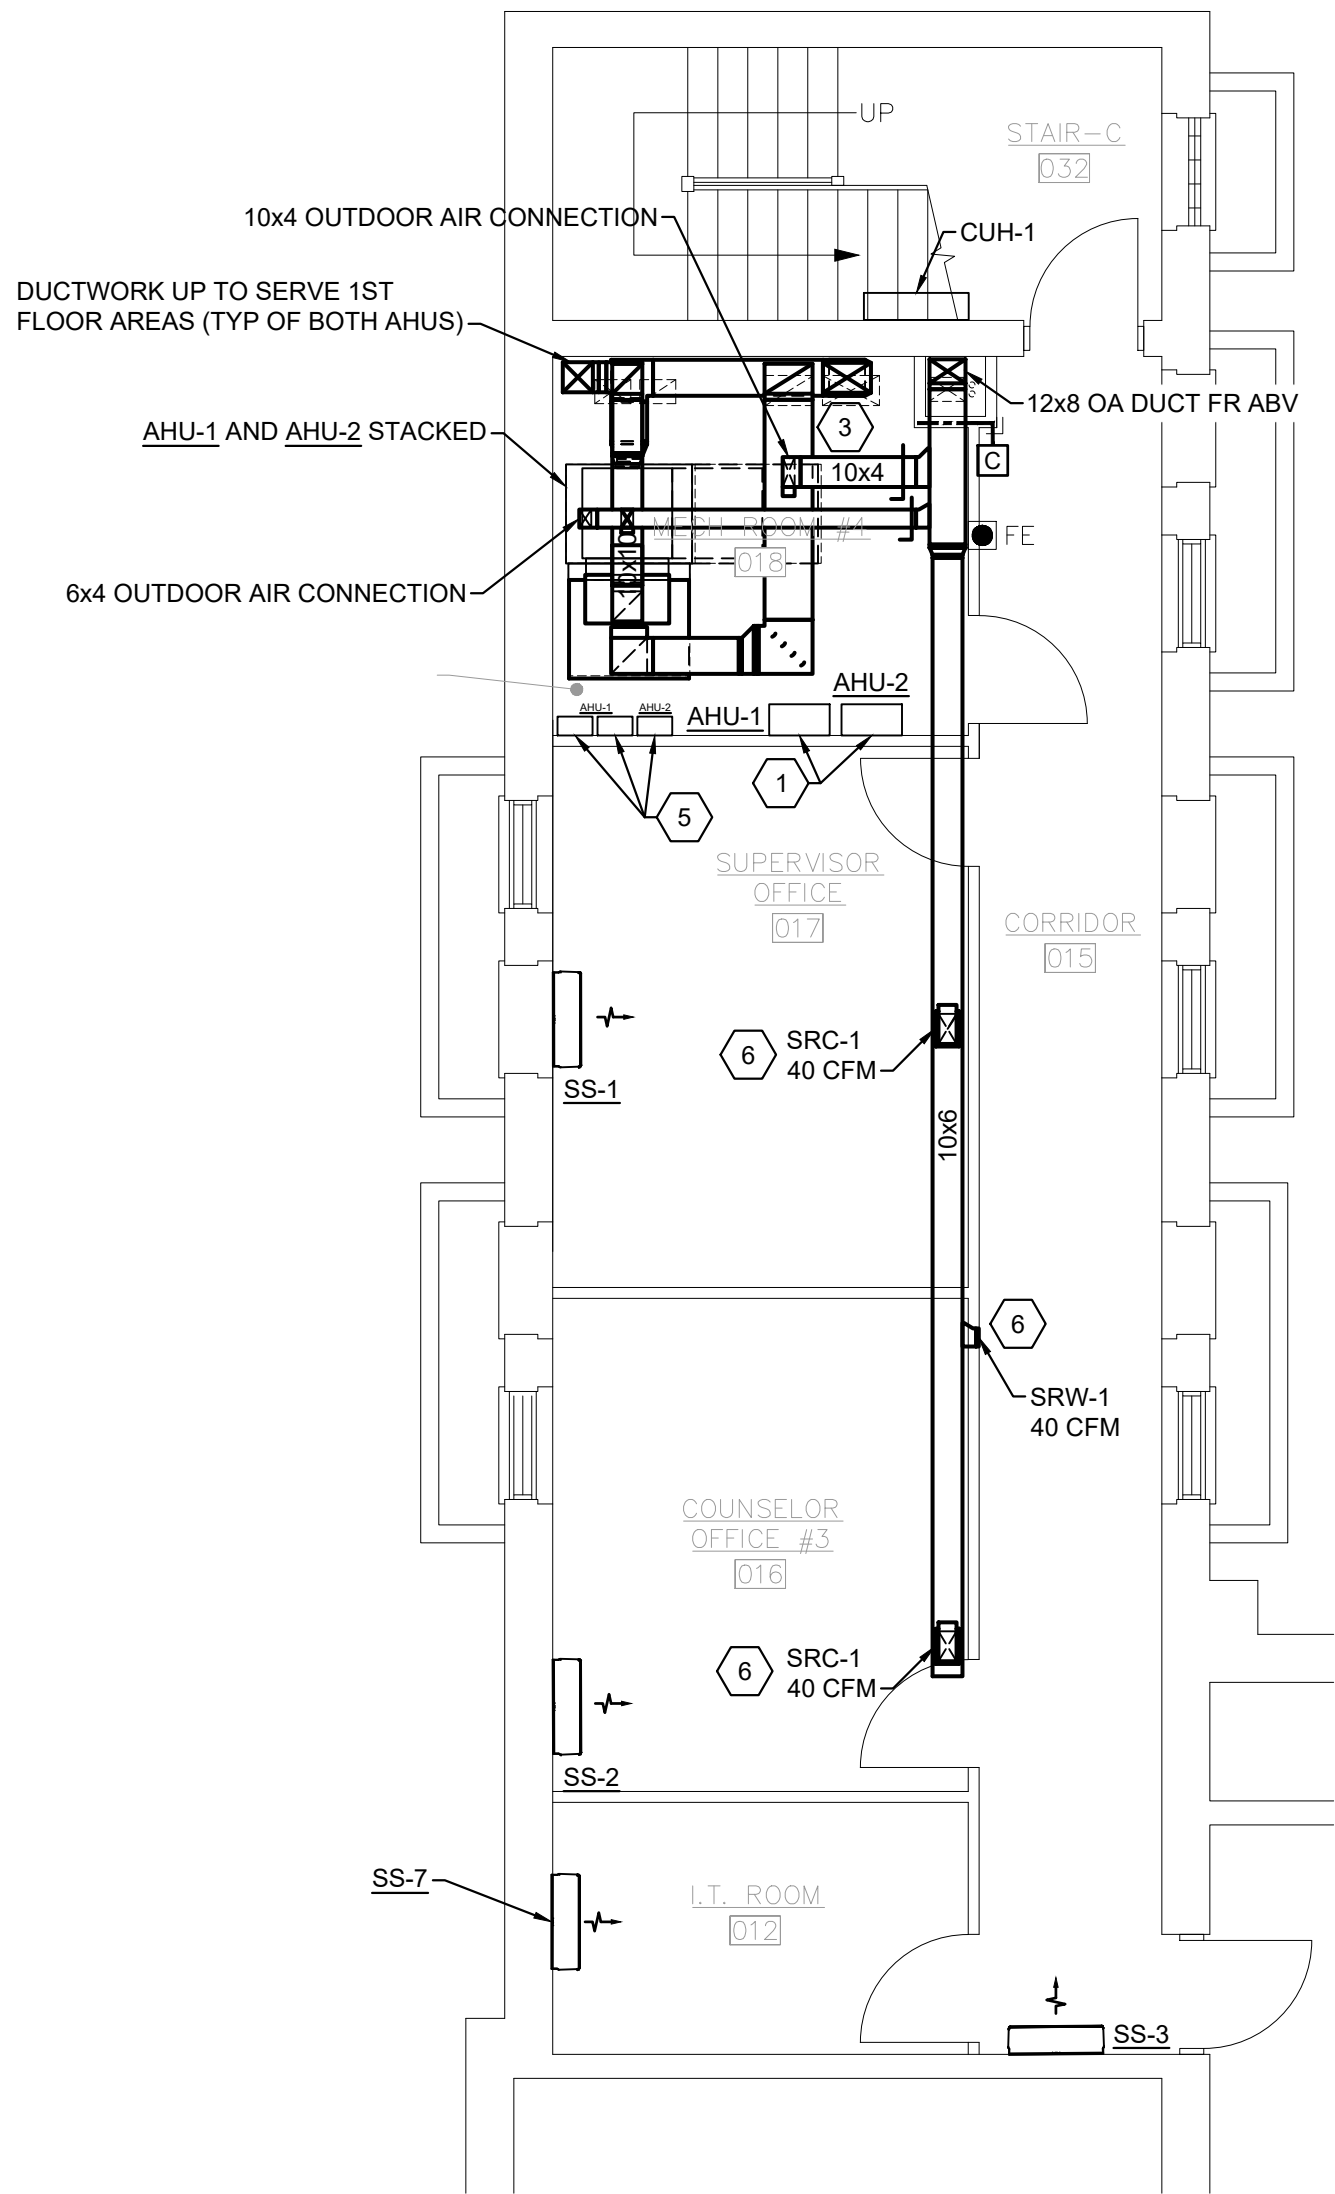

**BASEMENT PLAN - NEW WORK - BASE BID 2 - MECHANICAL**

Scale: 3/16" = 1'-0"

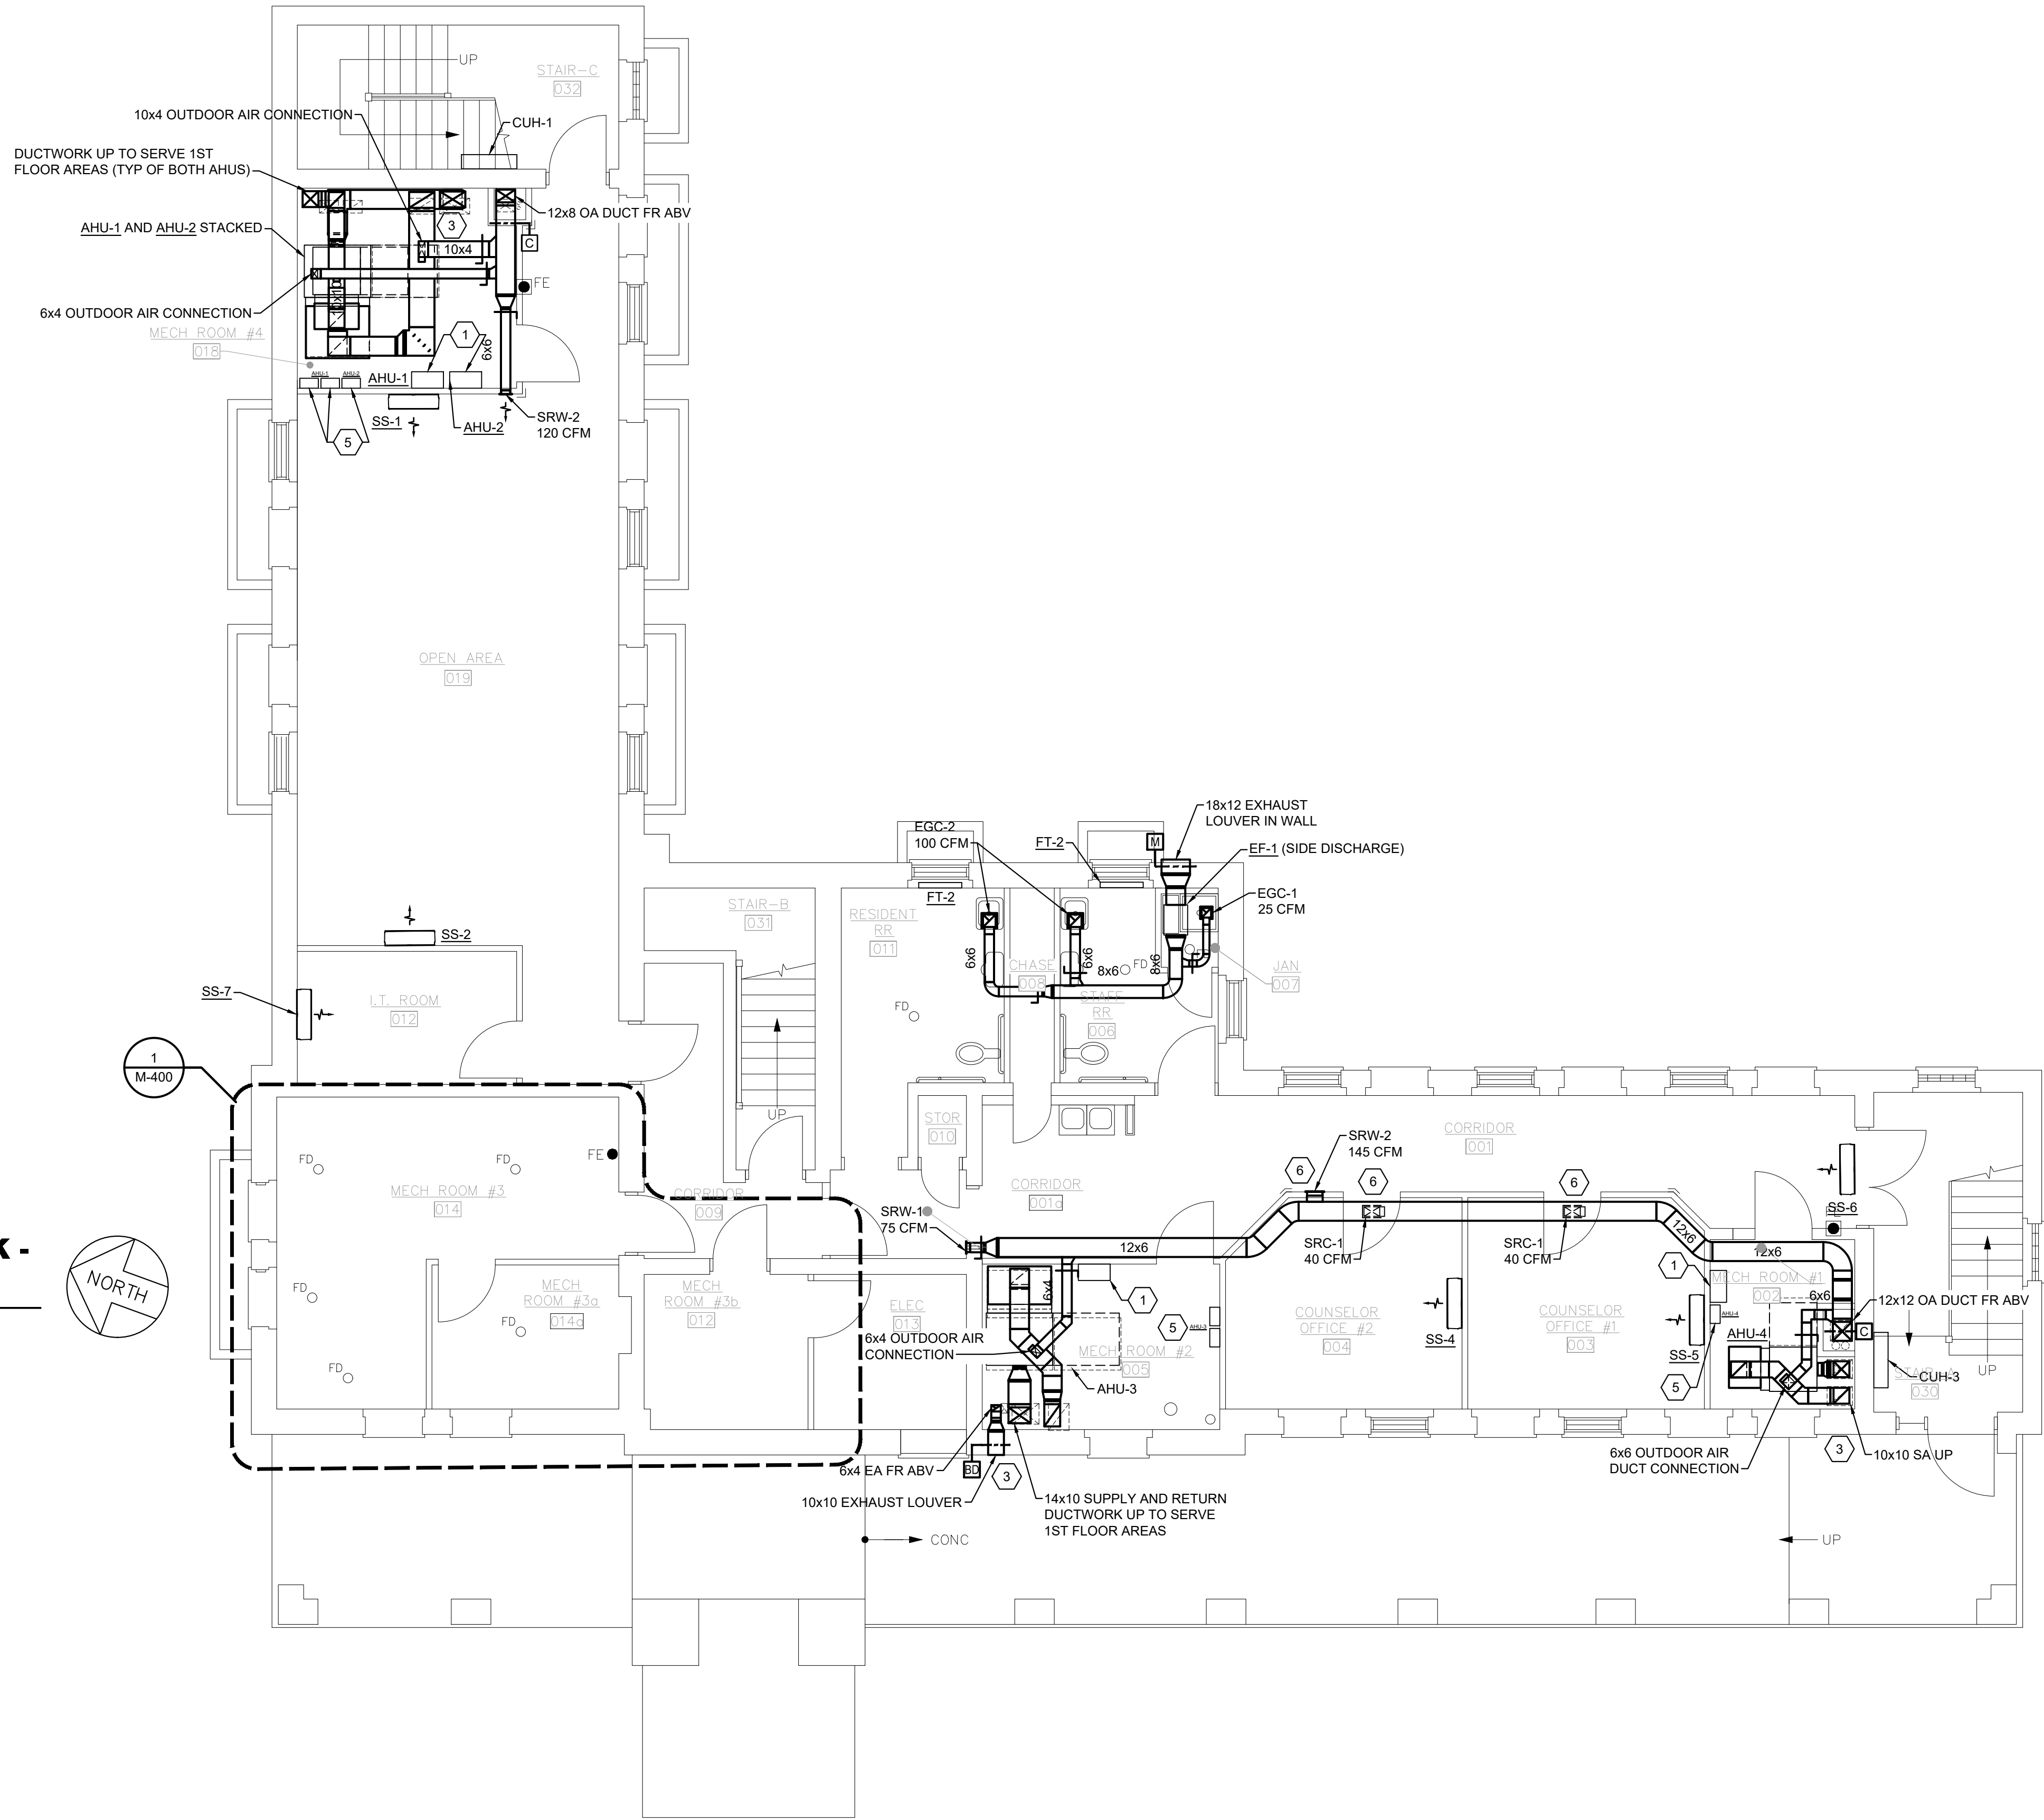

**BASEMENT PLAN - NEW WORK - BASE BID 1 - MECHANICAL**

Scale: 3/16" = 1'-0"

09/13/23	ADDENDUM #2
RECORD REVISIONS	
PROFESSIONAL'S SIGNATURE    DATE	
<b>UpStreet</b> ARCHITECTS, INC. 541 PHILADELPHIA ST.    911 MENOHER BLVD. INDIANA, PA 15701    JOHNSTOWN, PA 15905	
COMMONWEALTH OF PENNSYLVANIA DEPARTMENT OF GENERAL SERVICES HARRISBURG, PENNSYLVANIA	
D.G.S. PROJECT No. <b>C-0588-0015 PHASE 1</b>	
<b>LOYSVILLE YOUTH DEVELOPMENT CENTER- RENOVATIONS TO ZIMMERMAN- BINGAMAN (ZB) COTTAGE</b> DEPARTMENT OF HUMAN SERVICES LOYSVILLE, TYRONE TOWNSHIP, PERRY COUNTY, PA	
<b>BASEMENT PLAN - NEW WORK - MECHANICAL</b>	
CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS. VARIANCE FROM CONTRACT DOCUMENTS NOT PERMITTED WITHOUT PROFESSIONAL & BUREAU OF CONSTRUCTION APPROVAL.	
DRAWN BY W. MINAHAN	DATE 27 JUNE 2023
CHECKED BY T. HOVAN	SCALE AS NOTED
SHEET No. <b>M-200</b>	

VERIFY SCALE

BAR IS ONE (1) INCH LONG ON ORIGINAL DRAWING:  
0 1  
IF BAR IS NOT ONE (1) INCH LONG, ADJUST SCALE ACCORDINGLY