



- GENERAL NOTES**
- REFER TO FLOOR PLANS FOR QUANTITY AND LOCATIONS OF LIGHTING CONTROL DEVICES.
 - REFER TO LOW VOLTAGE LIGHTING CONTROL DEVICE SCHEDULES FOR ADDITIONAL INFORMATION.

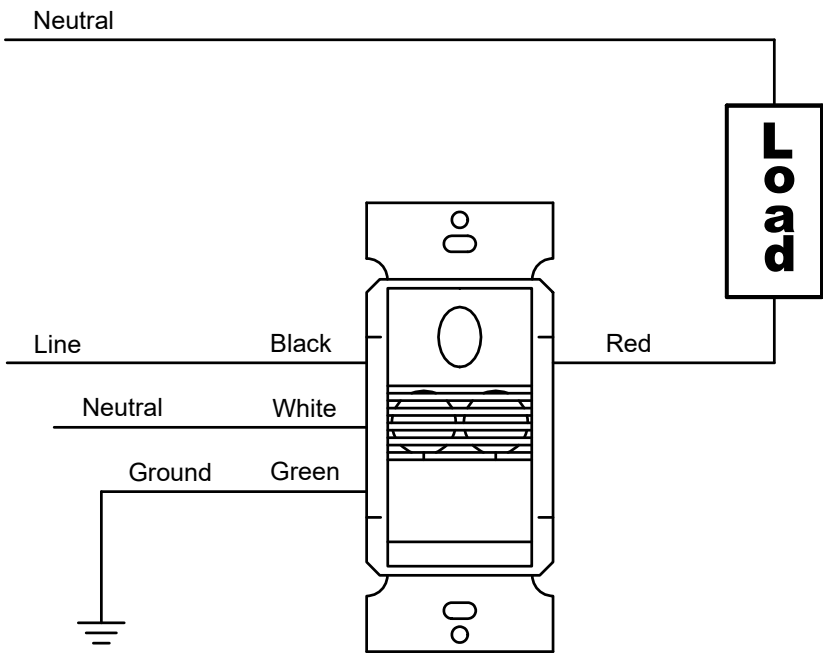

- NOTE:**
- REFER TO LOW VOLTAGE CONTROL SCHEDULES FOR WALL SWITCH SETTINGS AND TIME DELAY.
 - ON / OFF CONTROL ONLY.

- NOTES:**
- LIGHTING CONTROL PANEL REQUIRES A DEDICATED 120V CIRCUIT FOR POWER SUPPLY TRANSFORMERS.
 - CONTRACTOR TO PROVIDE & TERMINATE ALL LOW VOLTAGE CAT 5 DATA CABLE.
 - LIGHTING CONTROL PANEL SHALL BE INSTALLED IN NEMA 1 LOCKABLE ENCLOSURE.



1

TYPICAL DIGITAL LIGHTING CONTROL SYSTEM DETAIL

NOT TO SCALE

2


LINE VOLTAGE WALL SWITCH SENSOR (DUAL TECH)

NOT TO SCALE

3

EXTERIOR LIGHTING CONTROL SYSTEM WIRING DIAGRAM


NOT TO SCALE

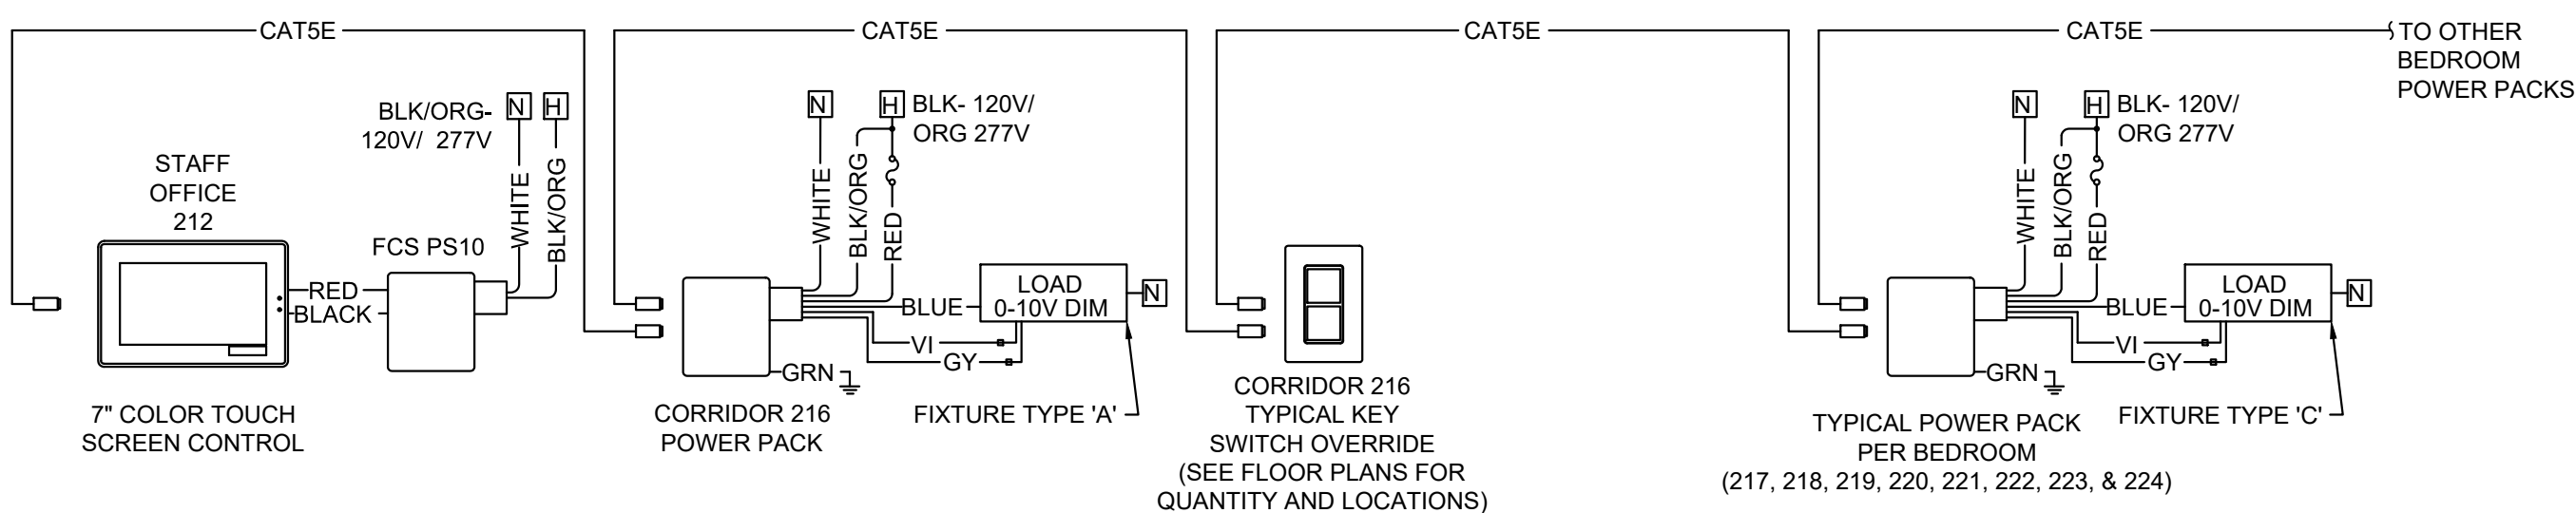

4

RESIDENT BEDROOM LIGHTING CONTROL SYSTEM DETAIL

NOT TO SCALE

RECORD REVISIONS			
			
PROFESSIONAL'S SIGNATURE DATE			
UpStreet ARCHITECTS, INC. 541 PHILADELPHIA ST. INDIANA, PA 15701 911 MENOHER BLVD. JOHNSTOWN, PA 15905			
COMMONWEALTH OF PENNSYLVANIA DEPARTMENT OF GENERAL SERVICES HARRISBURG, PENNSYLVANIA			
D.G.S. PROJECT No. C-0588-0015 PHASE 1			
LOYSVILLE YOUTH DEVELOPMENT CENTER- RENOVATIONS TO ZIMMERMAN- BINGAMAN (ZB) COTTAGE DEPARTMENT OF HUMAN SERVICES LOYSVILLE, TYRONE TOWNSHIP, PERRY COUNTY, PA			
DETAILS - ELECTRICAL			
VERIFY SCALE BAR IS ONE (1) INCH LONG ON ORIGINAL DRAWING: 0 1 IF BAR IS NOT ONE (1) INCH LONG, ADJUST SCALE ACCORDINGLY	CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS. VARIANCE FROM CONTRACT DOCUMENTS NOT PERMITTED WITHOUT PROFESSIONAL & BUREAU OF CONSTRUCTION APPROVAL.	DRAWN BY S. SMOLKO CHECKED BY S. MULHOLLEN	DATE 27 JUNE 2023 SCALE AS NOTED
	SHEET No. E-604		